


This document is the controlling and authoritative for the design, construction, and operation of the equipment shown herein. It is to be used for all purposes and shall prevail over any other drawings or documents.

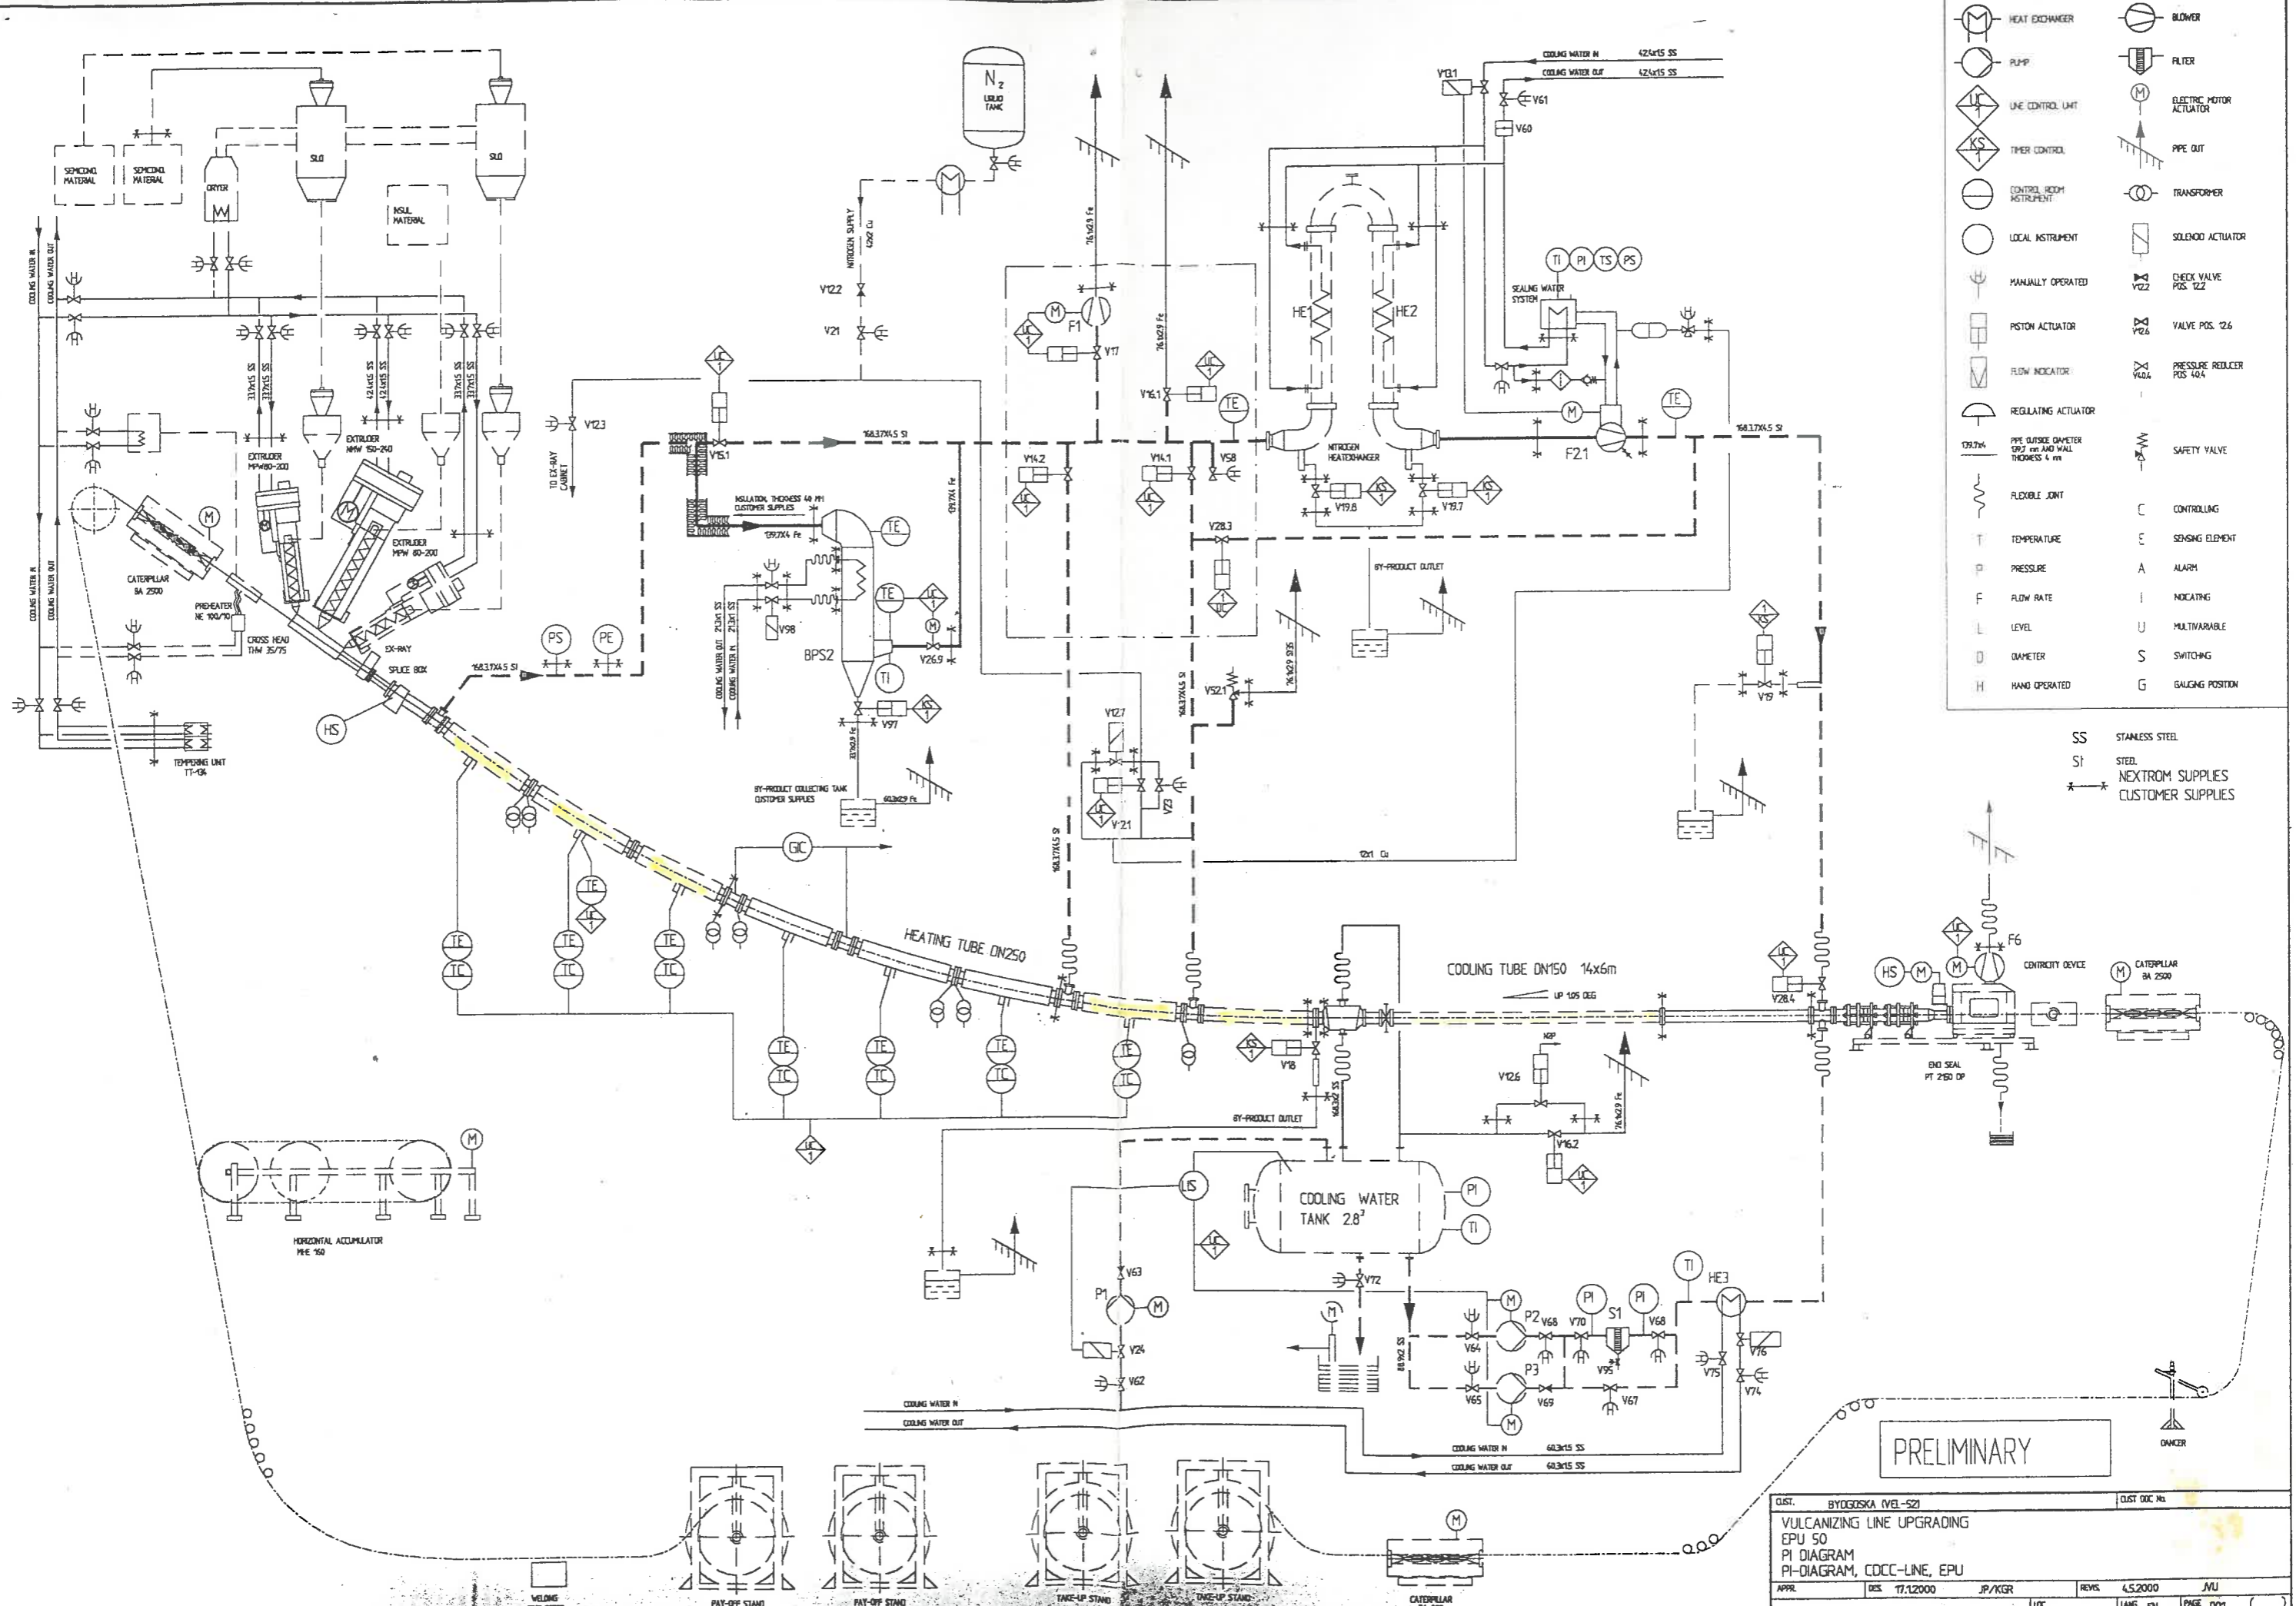

- | | | | |
|--|---|--|---------------------------|
| | HEAT EXCHANGER | | BLOWER |
| | PUMP | | FILTER |
| | LINE CONTROL UNIT | | ELECTRIC MOTOR ACTUATOR |
| | TIMER CONTROL | | PIPE OUT |
| | CONTROL ROOM INSTRUMENT | | TRANSFORMER |
| | LOCAL INSTRUMENT | | SOLENOID ACTUATOR |
| | MANUALLY OPERATED | | CHECK VALVE POS. 122 |
| | PISTON ACTUATOR | | VALVE POS. 126 |
| | FLOW INDICATOR | | PRESSURE REDUCER POS. 141 |
| | REGULATING ACTUATOR | | SAFETY VALVE |
| | PIPE OUTSIDE DIAMETER 69.3 mm AND WALL THICKNESS 4 mm | | |
| | FLEXIBLE JOINT | | |
| | TEMPERATURE | | |
| | PRESSURE | | |
| | FLOW RATE | | |
| | LEVEL | | |
| | DIAMETER | | |
| | HAND OPERATED | | |
| | | | CONTROLLING |
| | | | SENSING ELEMENT |
| | | | ALARM |
| | | | INDICATING |
| | | | MULTIVARIABLE |
| | | | SWITCHING |
| | | | GAUGING POSITION |

SS STAINLESS STEEL
 S1 STEEL
 * NEXTROM SUPPLIES
 * CUSTOMER SUPPLIES

PRELIMINARY

Q.S.T. BYDZOSKA (VEL-52)		Q.S.T. DOC No.	
VULCANIZING LINE UPGRADING			
EPU 50 PI DIAGRAM PI-DIAGRAM, COCC-LINE, EPU			
APPR.	DES.	REV.	DATE
	T.12.2000	4.5.2000	JU
SCALE 1:1		LANE EN	PAGE 001 ()
		DOC No.	REV.
		160584	C

A	1	000202	MU	
REV.	NUMBER	DATE	SEN.	MODIFICATIONS